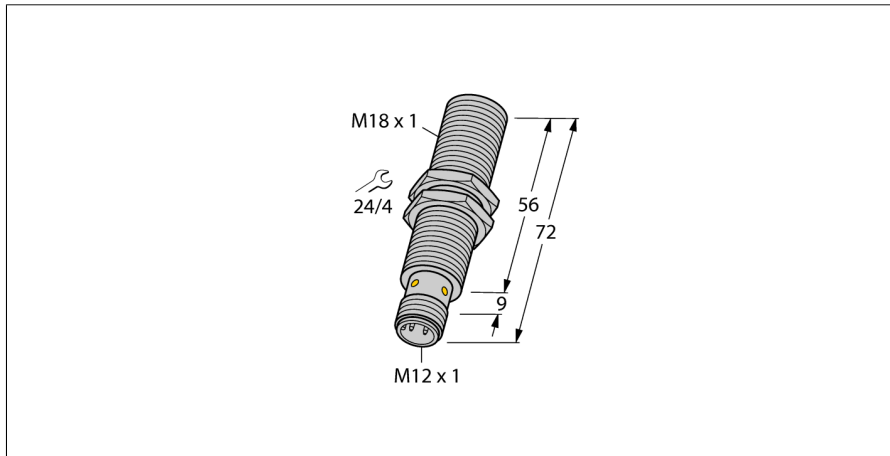



Inductive sensor
With analog output
BI8-M18-LI-EXI-H1141



- ATEX category II 1 G, Ex-zone 0
- ATEX category II 2 D, Ex-zone 21
- Threaded barrel, M18 x 1
- Chrome-plated brass
- 2-wire, 14...30 VDC
- Analog output
- 4...20 mA
- M12 x 1 male connector

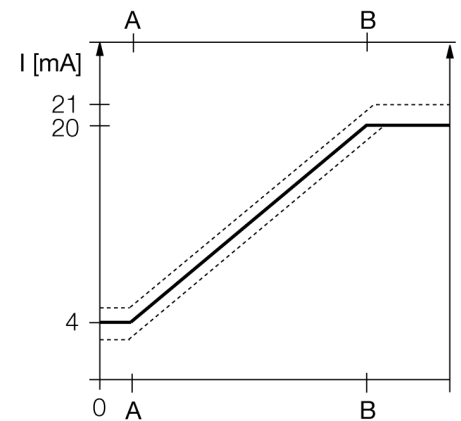
Wiring diagram



Functional principle

Inductive sensors with analog output from TURCK accomplish simple control tasks. They provide a distance-proportional current signal. Determined by the technology used, the maximum load in 2-wire technology is influenced by the sensor's operating voltage. The load's resistance must be selected so that the supply voltage of the sensor does not fall below 14 volts.

Measuring range



Type code	BI8-M18-LI-EXI-H1141
Ident-No.	1535604
Measuring range [A...B]	1...5mm
Mounting condition	flush
Repeatability	≤ 1 % of measuring range A - B ≤ 0.5 %, after warm-up 0.5 h
Linearity deviation	≤ 5 %
Temperature drift	≤ ± 0.06 % / K
Ambient temperature	-25...+70 °C in the explosion hazardous area see instruction leaflet
Operating voltage	14...30VDC at the electrical connection of the sensor
Residual ripple	≤ 10 % U _s
Rated insulation voltage	≤ 0.5 kV
Short-circuit protection	yes
Wire breakage / Reverse polarity protection	yes/ complete
Output function	2-wire, analog output
Current output	4...20mA
Load resistance current output	≤ [(U _s - 14 V) / 20 mA] kΩ
Measuring sequence frequency	200 Hz
Approval acc. to	KEMA 03 ATEX 1122 X Issue no. 2
Internal capacitance (C _i) / inductance (L _i)	0 nF / 0 μH
Device designation	⊕ II 1 G Ex ia IIC T6 Ga / II 2 D Ex ia IIC T85°C Db (max. U _i = 30 V, I _i = 120 mA, P _i = 600 mW)
Construction	threaded barrel, M18 x 1
Dimensions	72 mm
Housing material	metal, CuZn, chrome-plated
Material active area	plastic, PA
Max. tightening torque housing nut	25 Nm
Connection	male, M12 x 1
Vibration resistance	55 Hz (1 mm)
Shock resistance	30 g (11 ms)
IP Rating	IP67
MTTF	751 years acc. to SN 29500 (Ed. 99) 40 °C

Inductive sensor
With analog output
BI8-M18-LI-EXI-H1141






Distance D	2 x B
Distance W	12 mm
Distance T	3 x B
Distance S	1.5 x B
Distance G	24 mm

Diameter of the active area B \varnothing 18 mm



**Inductive sensor
With analog output
BI8-M18-LI-EXI-H1141**

Accessories

Type code	Ident-No.	Description	Design
BST-18B	6947214	Fixing clamp for threaded barrel devices, with dead-stop; material: PA6	
QM-18	6945102	Quick-mount bracket with dead-stop; material: Chrome-plated brass Male thread M24 x 1.5. Note: The switching distance of proximity switches can be reduced by the use of quick-mount brackets.	
MW-18	6945004	Mounting bracket for threaded barrel devices; material: Stainless steel A2 1.4301 (AISI 304)	
BSS-18	6901320	Mounting bracket for smooth and threaded barrel devices; material: Polypropylene	
IM33-11EX-HI	7506443	Isolating transducers; 1-channel; power supply of 2-wire measuring transducers with HART® communication as well as connection of active 2-wire and passive 3-wire transmitters	

Inductive sensor

With analog output

BI8-M18-LI-EXI-H1141

TURCK
works

Industrial
Automation

Operating manual

Intended use

This device fulfills the directive 94/9/EC and is suited for use in explosion hazardous areas according to EN60079-0:2009, -11:2012, -26:2007. In order to ensure correct operation to the intended purpose it is required to observe the national regulations and directives.

For use in explosion hazardous areas conform to classification

II 1 G and II 2 D (Group II, Category 1 G, electrical equipment for gas-atmospheres and category 2 D, electrical equipment for dust atmospheres)

Marking (see device or technical data sheet)

Ⓔ II 1 G Ex ia IIC T6 Ga und Ⓔ II 2 D Ex ia IIIC T85°C Db nach EN 60079-0, -11 und -26

Local admissible ambient temperature

-25...+65 °C

Installation / Commissioning

These devices may only be installed, connected and operated by trained and qualified staff. Qualified staff must have knowledge of protection classes, directives and regulations concerning electrical equipment designed for use in explosion hazardous areas. Please verify that the classification and the marking on the device comply with the actual application conditions.

This device is only suited for connection to approved Exi circuits compliant to EN60079-0 and -11. Please observe the maximum admissible electrical values.

After connection to other circuits the sensor may no longer be used in Exi installations. When interconnected to (associated) electrical equipment, it is required to perform the "Proof of intrinsic safety" (EN60079-14).

Installation and mounting instructions

Avoid static charging of cables and plastic devices. Please only clean the device with a damp cloth. Do not install the device in a dust flow and avoid build-up of dust deposits on the device.

If the devices and the cable could be subject to mechanical damage, they must be protected accordingly. They must also be shielded against strong electro-magnetic fields.

The pin configuration and the electrical specifications can be taken from the device marking or the technical data sheet.

In order to avoid contamination of the device, please remove possible blanking plugs of the cable glands or connectors only shortly before inserting the cable or opening the cable socket.

service / maintenance

Repairs are not possible. The approval expires if the device is repaired or modified by a person other than the manufacturer. The most important data from the approval are listed.