

# MODEL: T102


## 24 HOUR DIAL TIME SWITCH



SINGLE POLE SINGLE THROW (SPST)  
 40 AMP. RESISTIVE, INDUCTIVE, TUNGSTEN  
 OR 1000 VA PILOT DUTY 120-277 VOLT AC;  
 2 HP (24 FLA) - 120V AC; 5 HP (28 FLA) - 240V AC

**CLOCK MOTOR: 208-277 VOLTS - 60 HZ.**


(TO ORDER CLOCK MOTOR REPLACEMENT, SPECIFY PART No. WG--ON MOTOR COVER)

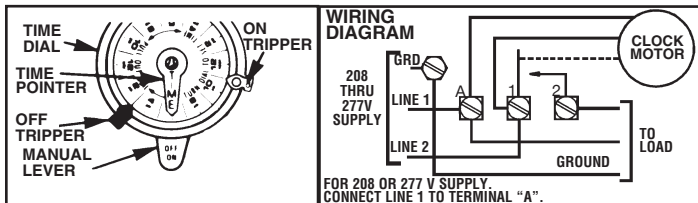

**WIRING INSTRUCTIONS:** To wire switch follow diagram above. Use solid or stranded **COPPER** *only* wire with insulation to suit installation. See gauge selection table for normal service applications. To make power connections remove 1/2 inch of insulation from wire ends. Insert bare ends of wire under the pressure plate of terminals. Use 3/16 or larger screwdriver to tighten terminal screws firmly. (25 lb-in minimum).

**REPLACE INSULATOR BEFORE TURNING ON ELECTRICITY.**

MINIMUM COPPER WIRE SIZE (AWG)	MAX. LOAD (AMP)	MIN. INSULATION TEMP(°C)	75°C INSULATION MAX. MOTOR LOAD (HP)			
			SINGLE PHASE		3 PHASE	
			120 V.	240 V.	208 V.	240 V.
14	15	60	1/2	2		
12	20	60	1	2 1/2		
10	30	60	2	3	N/A	N/A
8	40	75	-	5		

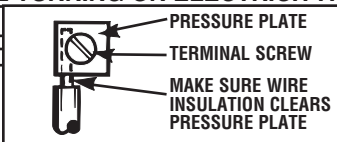

### PROGRAMMING INSTRUCTIONS

- TO SET "ON" AND "OFF" TIMES:** Hold trippers against edge of **CLOCK-DIAL**, pointing to time (AM or PM) when **ON** and **OFF** operations are desired, tighten tripper screws firmly. For additional tripper pairs on **CLOCK-DIAL** order 156T1978A.
- TO SET TIME-OF-DAY:** Pull **CLOCK-DIAL** outward. Turn in either direction and align the exact time-of-day on the **CLOCK-DIAL** (the time now, when switch is being put into operation) to the pointer. **DO NOT MOVE POINTER.**

### OPERATING INSTRUCTIONS

- TO OPERATE SWITCH MANUALLY:** Move **MANUAL LEVER** below **CLOCK-DIAL** left or right as indicated by arrows. This will not effect next operation.
- IN CASE OF POWER FAILURE,** reset **CLOCK-DIAL** to proper time-of-day. See programming instructions.

**INTERMATIC INCORPORATED**  
 SPRING GROVE, ILLINOIS 60081-9698